



DOOR SCHEDULE						
MARK	SIZE			MATL	GLAZING	NOTE(S)
	WD	HT	THK			
D2	3'-0"	6'-8"	1 3/4"	STEEL	----- INSUL.	

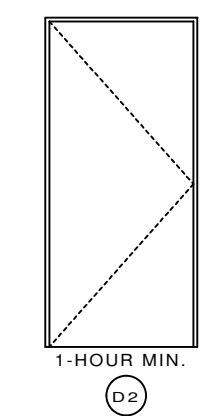

EXTERIOR WINDOW SCHEDULE						
ALL EXTERIOR WINDOWS TO BE MARVIN INTEGRITY ALL-ULTREX SERIES						
MARK	CASEMENT WINDOW	R.O.		MATL	GLAZING	NOTE(S)
		WD	HT			
A	IFCA2650 2W	5'-0"	5'-0"	PULTRUDED FIBERGLASS	LoE ⁺ -366 GLASS	1,2

NOTE(S):
 1. Use through jamb installation method. (Install per. manufactures installation instructions)
 2. UNIT MEETS OR EXCEEDS THE FOLLOWING DIMENSIONS:
 Clear openable Area of 5.7 sq. ft.
 Clear openable width of 20"
 Clear openable height of 24"

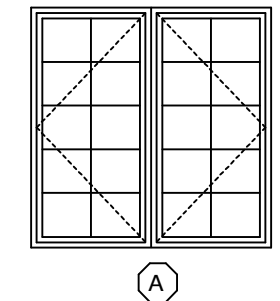


- SPECIFICATIONS:**
- Accessibility (IBC Chapter 11, MSBC1341)
 - Draft stops: (IBC 717.4.717.3) Floor areas not to exceed 1,000 sq. ft. Roof areas not to exceed 3,000 sq. ft.
 - Ventilation (IBC 1203) 1/200 e.f. 50% Ridge, 50% Eve.
 - Fire Exit Hardware (IBC 1008.1.9)

- PLAN NOTES:**
- EXTERIOR WALLS: 8" & 12" C.M.U. AS NOTED
 - INTERIOR WALLS: 2x4 METAL STUD FRAME @ 16" O.C. W/ 5/8" GYP FIN. 12" C.M.U. AS NOTED
 - VERIFY ALL EXTERIOR AND INTERIOR FINISHES & COLOR SELECTIONS W/ OWNER
 - SECOND FLOOR TO REMAIN UNFINISHED ROUGH-IN ONLY

- INTERIOR C.M.U. WALL REINFORCEMENT:**
- TYPICAL WALL REINFORCEMENT SHALL BE #5 CENTERED IN EACH CORE @ 48" O.C. FULL HEIGHT OF THE WALL U.N.O.
 - PROVIDE WALL REINFORCEMENT AT ALL CORNERS AND JAMBS
 - VERTICAL REINFORCING SHALL BE CONTINUOUS WITH 48 BAR DIAMETER LAPS AT SPLICES

CONSTRUCTION DOCUMENTS

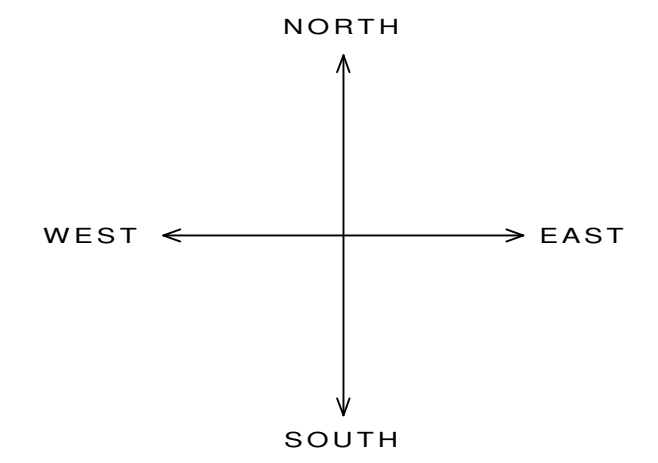

SECOND FLOOR PLAN
 SCALE: 1/4" = 1'-0"

ISANTI FIRE DISTRICT
 ISANTI, MINNESOTA 55040

PROJECT # : 1006
 DATE : 4/22/10
 REV. : 5/20/10
 REV. : 5/24/10
 REV. : 8/18/10
 REV. : 8/27/10

103