


SPECIFICATIONS:

1. Accessibility (IBC Chapter 11, MSBC1341)
2. Draft stops (IBC 717.4, 717.3) Floor areas not to exceed 1,000 sq. ft. Roof areas not to exceed 3,000 sq. ft.
3. Ventilation (IBC 1203) 1/300 s.f. 50% Ridge, 50% Eve.
4. Fire Exit Hardware (IBC 1008.1.9)

PLAN NOTES:


1. EXTERIOR ATTIC WALLS: 2x8 WOOD STUD FRAMED @ 16" O.C.
 A. HARDY BD. CEMENT SIDING
 B. TYVEK WRAP OR EQUAL
 C. 1/2" EXTERIOR WALL SHEATHING
 D. R-19 INSUL. 6 MIL POLY VAPOR BARRIER
 E. 5/8" GYP. FIN.
2. VERIFY ALL EXTERIOR AND INTERIOR FINISHES & COLOR SELECTIONS W/ OWNER

DOOR SCHEDULE					
MARK	SLIDING PATIO DR.	SIZE		MATL	GLAZING
		WD	HT		
D7	ISPD6068	6'-0"	6'-10"	PULTRUDED FIBERGLASS	LoE ³ -366 GLASS
D2		3'-0"	6'-8"	STEEL	

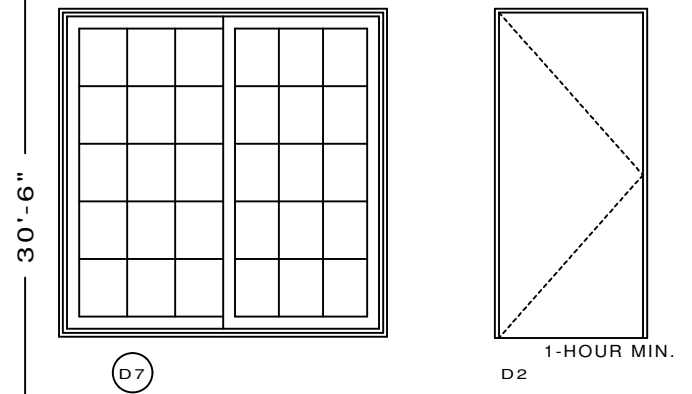


EXTERIOR WINDOW SCHEDULE						
ALL EXTERIOR WINDOWS TO BE MARVIN INTEGRITY ALL-ULTRIX SERIES						
MARK	CASEMENT WINDOW	R.O.		MATL	GLAZING	NOTE(S)
		WD	HT			
A	IFCA2650 2W	5'-0"	5'-0"	PULTRUDED FIBERGLASS	LoE ³ -366 GLASS	1,2

- NOTE(S):
1. Install per. manufactures installation instructions.
 2. UNIT MEETS OR EXCEEDS THE FOLLOWING DIMENSIONS:
 Clear openable Area of 5.7 sq. ft.
 Clear openable width of 20"
 Clear openable height of 24"

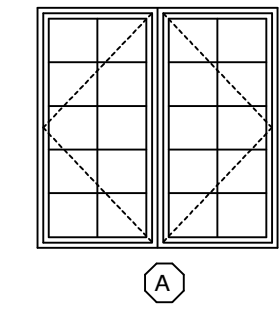

THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"

CONSTRUCTION DOCUMENTS

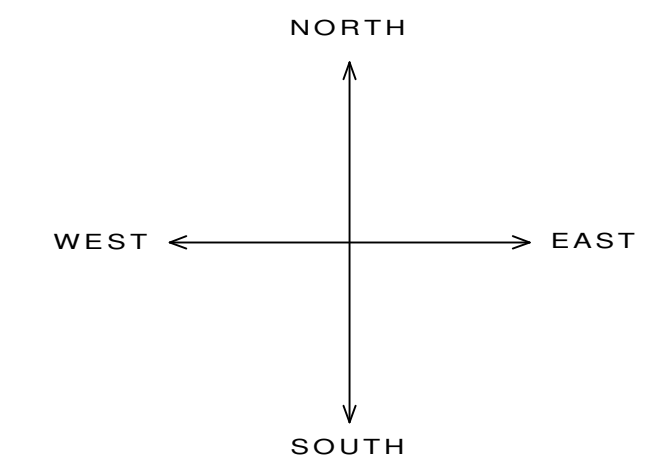

ISANTI FIRE DISTRICT
ISANTI, MINNESOTA 55040

PROJECT # : 1006
DATE : 4/22/10
REV. : 5/20/10
REV. : 5/24/10
REV. : 8/18/10
REV. : 8/27/10

104