


C.M.U. WALL REINFORCEMENT SCHEDULE		
MARK	THICKNESS	REINFORCEMENT
W1	12"	#5 VERT @ 48" O.C.
W1A	8"	#5 VERT @ 48" O.C.
W2	12"	#5 VERT @ 32" O.C.



NOTE:  
1. PROVIDE HOOKED DOWELS AT FOOTING TO MATCH VERTICAL REINFORCEMENT.

C.M.U. PIER SCHEDULE			
MARK	SIZE	REINFORCEMENT	REMARKS
P1	12x16	( 1 ) #5 @ 8" O.C.	( 2 ) BARS TOTAL
P1A	8x16	( 1 ) #5 @ 8" O.C.	( 2 ) BARS TOTAL
P2	12x24	( 1 ) #5 @ 8" O.C.	( 3 ) BARS TOTAL
P3	8x16	( 1 ) #4 @ 8" O.C.	( 2 ) BARS TOTAL

NOTE(S):  
1. PIER REINFORCEMENT SHALL EXTEND FROM FOOTING TO ROOF.  
2. REBAR LAP PER. TYP. NOTES SHEET S107.  
3. PROVIDE HOOKED DOWELS AT FOOTING TO MATCH VERTICAL REINFORCEMENT.

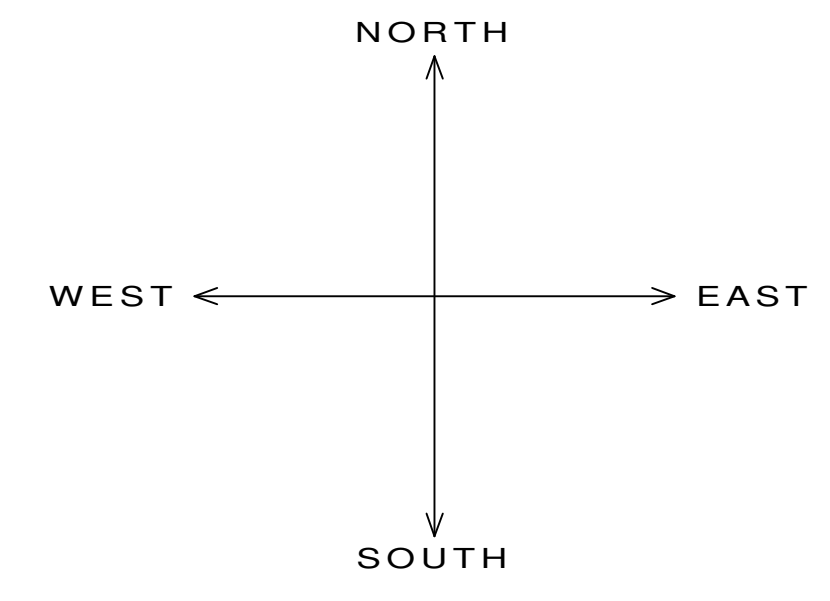

- PLAN NOTES:
1. TYPICAL PERIMETER FOOT SHALL BE 3'-0" WIDE BY 12" DEEP WITH ( 3 ) #5 CONTINUOUS AT BOTTOM U.N.O.
  2. TYPICAL THICKEN SLAB 24" @ BASE 12" DEEP WITH ( 2 ) # 5 CONTINUOUS AT BOTTOM U.N.O.
  3. TYPICAL INTERIOR C.M.U. WALL REINFORCEMENT SHALL BE #5 CENTERED IN EACH CORE @ 48" O.C. FULL HEIGHT OF THE WALL U.N.O.
  4. PROVIDE FULL HEIGHT WALL REINFORCEMENT AT ALL CORNERS AND JAMBS. PROVIDE ( 1 ) #5 @ CORNERS AND CONTROL JOINTS AND ( 2 ) #5 @ JAMBS.
  5. EXTERIOR C.M.U. WALL REINFORCEMENT SHALL BE PER. SCHEDULE ( THIS SHEET )

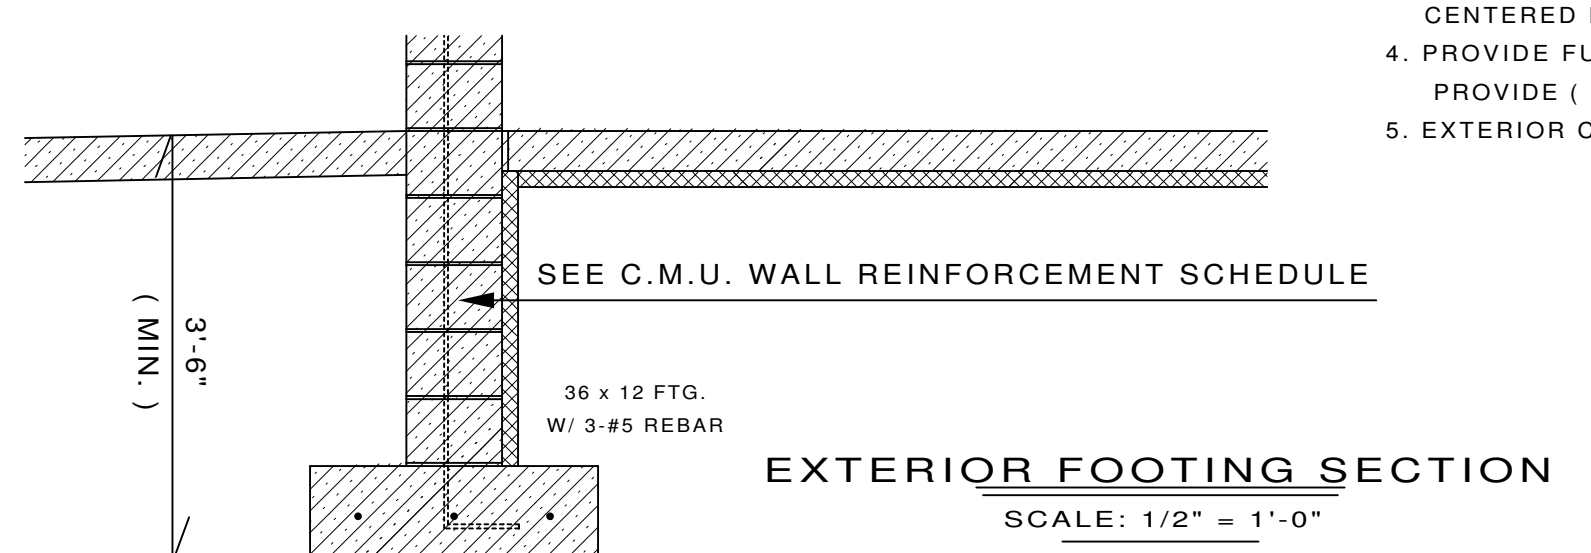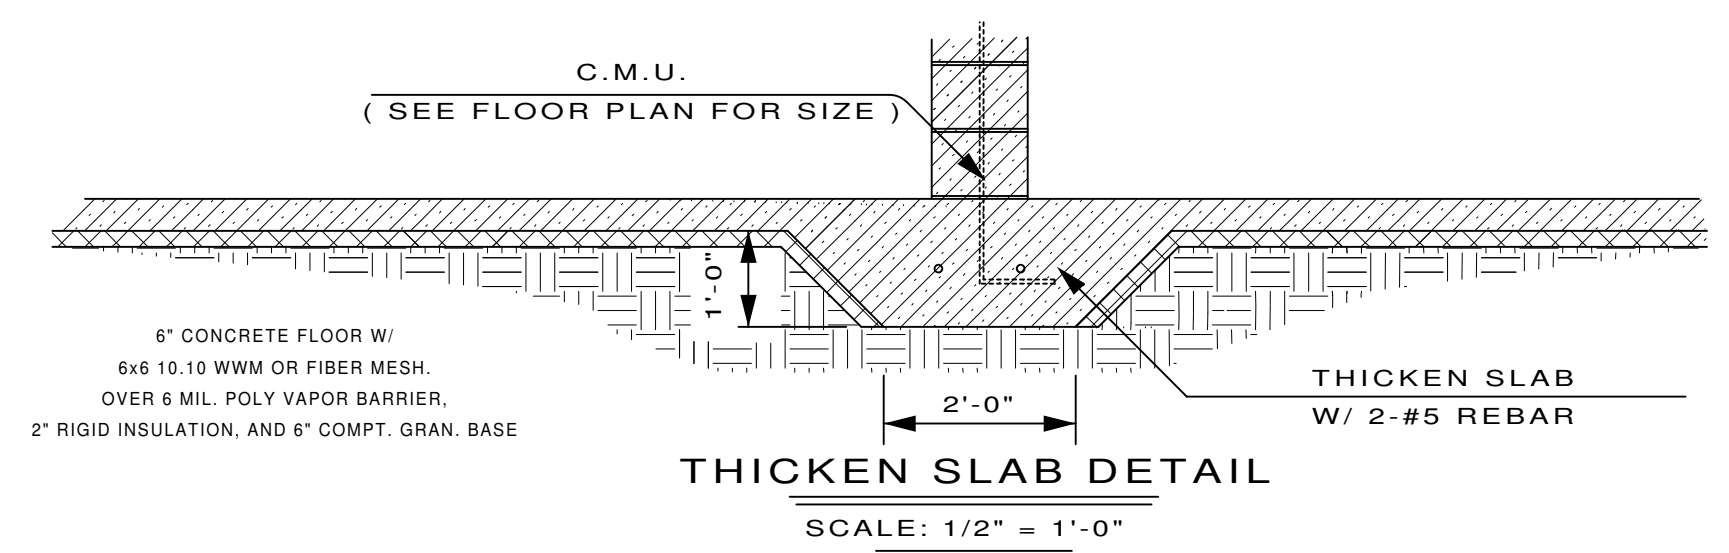

FOUNDATION  
SCALE: 1/4" = 1'-0"

**ISANTI FIRE DISTRICT**  
ISANTI, MINNESOTA 55040

PROJECT # : 1006  
DATE : 4/22/10  
REV. : 5/20/10  
REV. : 5/24/10  
REV. : 6/18/10  
REV. : 6/27/10

S106

CONSTRUCTION DOCUMENTS